

## FGP 190/3 - FGP 250/3 - FGP 350/3 - FGP 450/3

Light oil burners at three stages. They are composed by: fan at high pressurisation, combustion head with adjustment at high efficiency and high flame stability and hydraulic system of regulation combustive air on the three stages of flame.

Compact overall dimensions and disposition rationalized of the components with accessibility facilitated for the operations of setting and maintenance.

Complete of nozzles, flexible pipes, line filter.

Complete of flange and gasket for installation on generator.

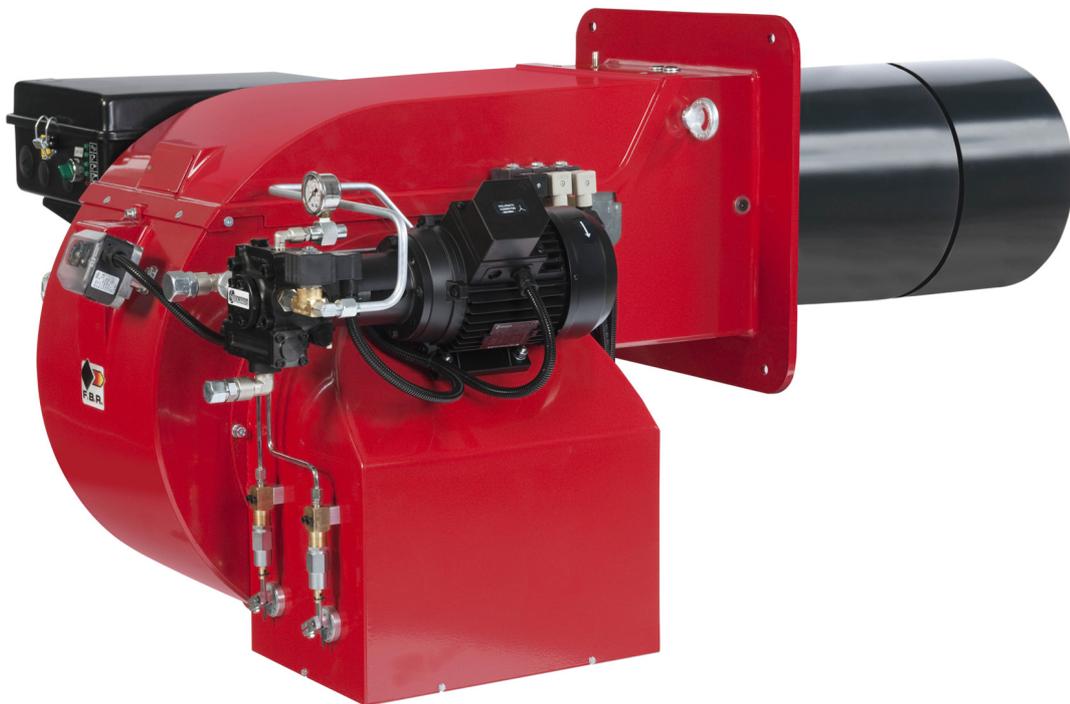


Fig. 1 FGP 350/3

MODEL		FGP 190/3	FGP 250/3	FGP 350/3	FGP 450/3
Flow min. - max. *	[kg/h]	60-206	80-250	140-350	160-450
Thermal power min. - max. *	[Mcal/h]	600-2060	800-2500	1400-3500	1600-4500
Thermal power min. - max. *	[kW]	700-2390	930-2900	1620-4060	1850-5220
Fuel:		LIGHT-OIL 1.5°E a 20°C = 6.2 cSt = 35 sec Redwood N°1			
Intermittent working operation (min. 1 stop every 24 hours) at 3 stages					
Environmental conditions operation / storage:		-15...+40°C / -20...+70°C , humidity max. 80%			
Max temperature combustion air	[°C]	60			
Nominal electric power	[kW]	6	9	11	13
Fan motor	[kW]	5.5	7.5	9	11
Pump motor	[kW]	0.75	1.1	1.5	1.5
Nominal absorption powers	[A]	11.5	15.5	19	21.7
Nominal absorption auxiliary	[A]	0.3	0.5	0.6	0.6
Power supply:		3~400V, 1/N~230V-50Hz			
Degree of electric protection:		IP40			
Noisiness ** min. - max.	[dB(A)]	83-85	84-85	86-86	88-89
Burner weight	[kg]	125	135	208	218

\* Reference conditions: Environment temperature 20°C - Barometric pressure 1013 mbars - Altitude 0 metre (sea level)

\*\* Measured sonorous pressure in the laboratory combustion, with functional burner on beta boiler to 1 metre of distance (UNI EN ISO 3746 law).

## FIRING RATES

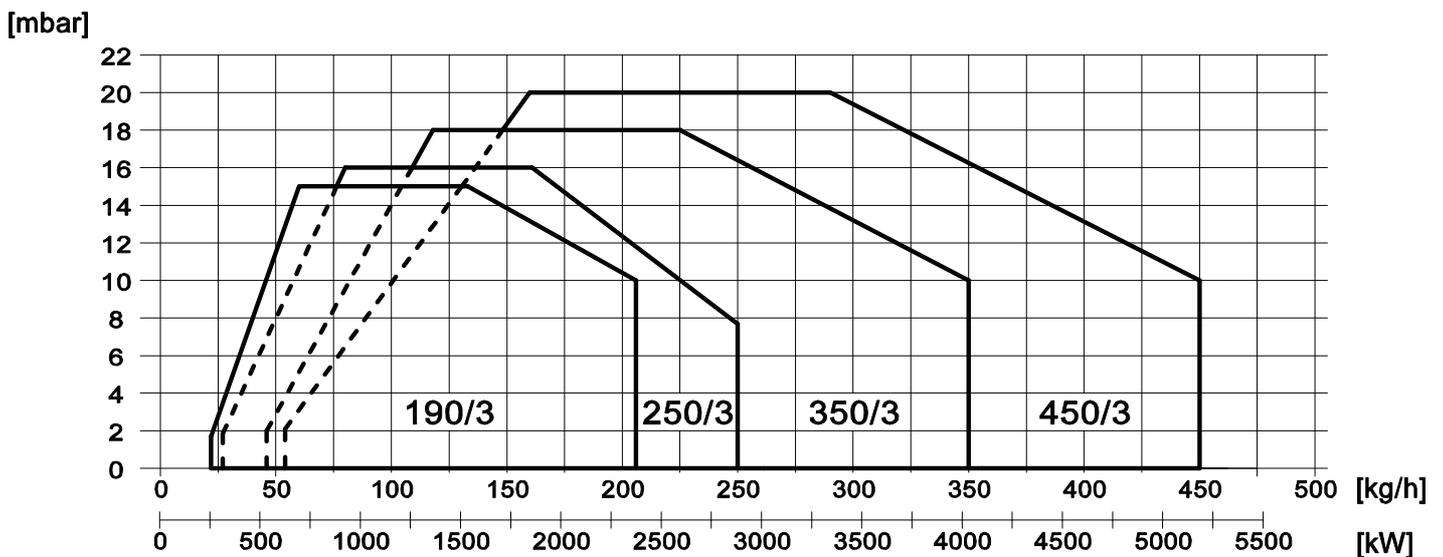


Fig. 2 X = Thermal power Y = Pression in the combustion chamber

The firing rates has been obtained based on test boilers in accordance with EN267 standards and are indicative of matching the burner to the boiler. For the correct operation of the burner bruciatore, combustion chamber dimensions must be in accordance with current regulation. In case of non-compliance, contact the manufacturer.



**FBR**  
**DIMENSIONS [MM]**


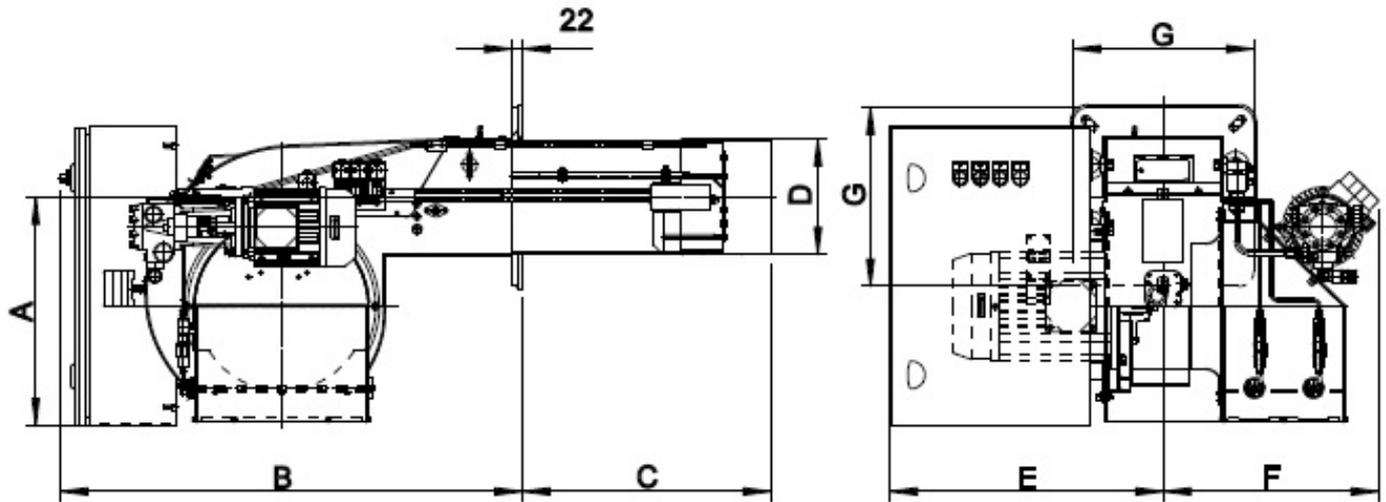


Fig. 3 Dimensions FGP 190/3 - FGP 250/3 - FGP 350/3 - FGP 450/3

MODEL	A	B	C	D	E	F	G
FGP 190/3	460	921	495	234	545	429	360
FGP 250/3	460	921	500	271	545	460	360
FGP 350/3	481	1090	535	334	700	517	490
FGP 450/3	481	1090	560	380	700	517	490

**BOILER PLATE**



The dimensions of the boiler plate must be as indicated in the drawing.

Fig. 4 Boiler plate

MODEL	I min	I *	I max	L min	L *	L max	M
FGP 190/3	396	424	438	245	280	320	M14
FGP 250/3	396	424	438	280	280	320	M14
FGP 350/3	552	552	580	350	350	450	M14
FGP 450/3	552	552	580	390	390	450	M14

\* Suggested dimension of connection between burner and generator.

## PRODUCT SPECIFICATION

### SHORT DESCRIPTION

Light-oil burners at 3 stages.

### DETAILED SPECIFICATION

Light-oil burner 3 stages; composed by:

- Fan at high pressurisation;
- Combustion head with adjustment at high performance and elevated flame stability;
- Flange and insulating gasket for fixing at boiler;
- Three-phase power supply;
- Photoresistance for flame detection;
- IP 40 electric protection level;
- Easy extraction of combustion head without get off the burners by bolier;
- Timer for the activation of the three stage valve: factory setting = 18sec;
- Dedicated motor for the activation of the light-oil pump.

### CONFORMING TO:

- CE rules;
- 2014/30/UE Directive E.M.C.;
- 2014/35/UE Directive L.V.;
- 2014/68/EU Directive M.D.;
- 97/23/CE Directive P.E.D.;
- Reference rules: EN267 (liquid fuel) - EN746-2 (industrial thermoprocessing equipment).

### STANDARD EQUIPMENT

- Flexible hoses for connection;
- Line filter;
- Isomart gasket;
- Nozzles;
- Flange with insulating gasket;
- Burner nameplate;
- Warranty;
- Instruction handbook for installation, use and maintenance.

### OPTIONAL

- Noise protection.